


Date: 05-21-12
 Scale: NTS
 Drawn By: JDM
 Checked By: WLP

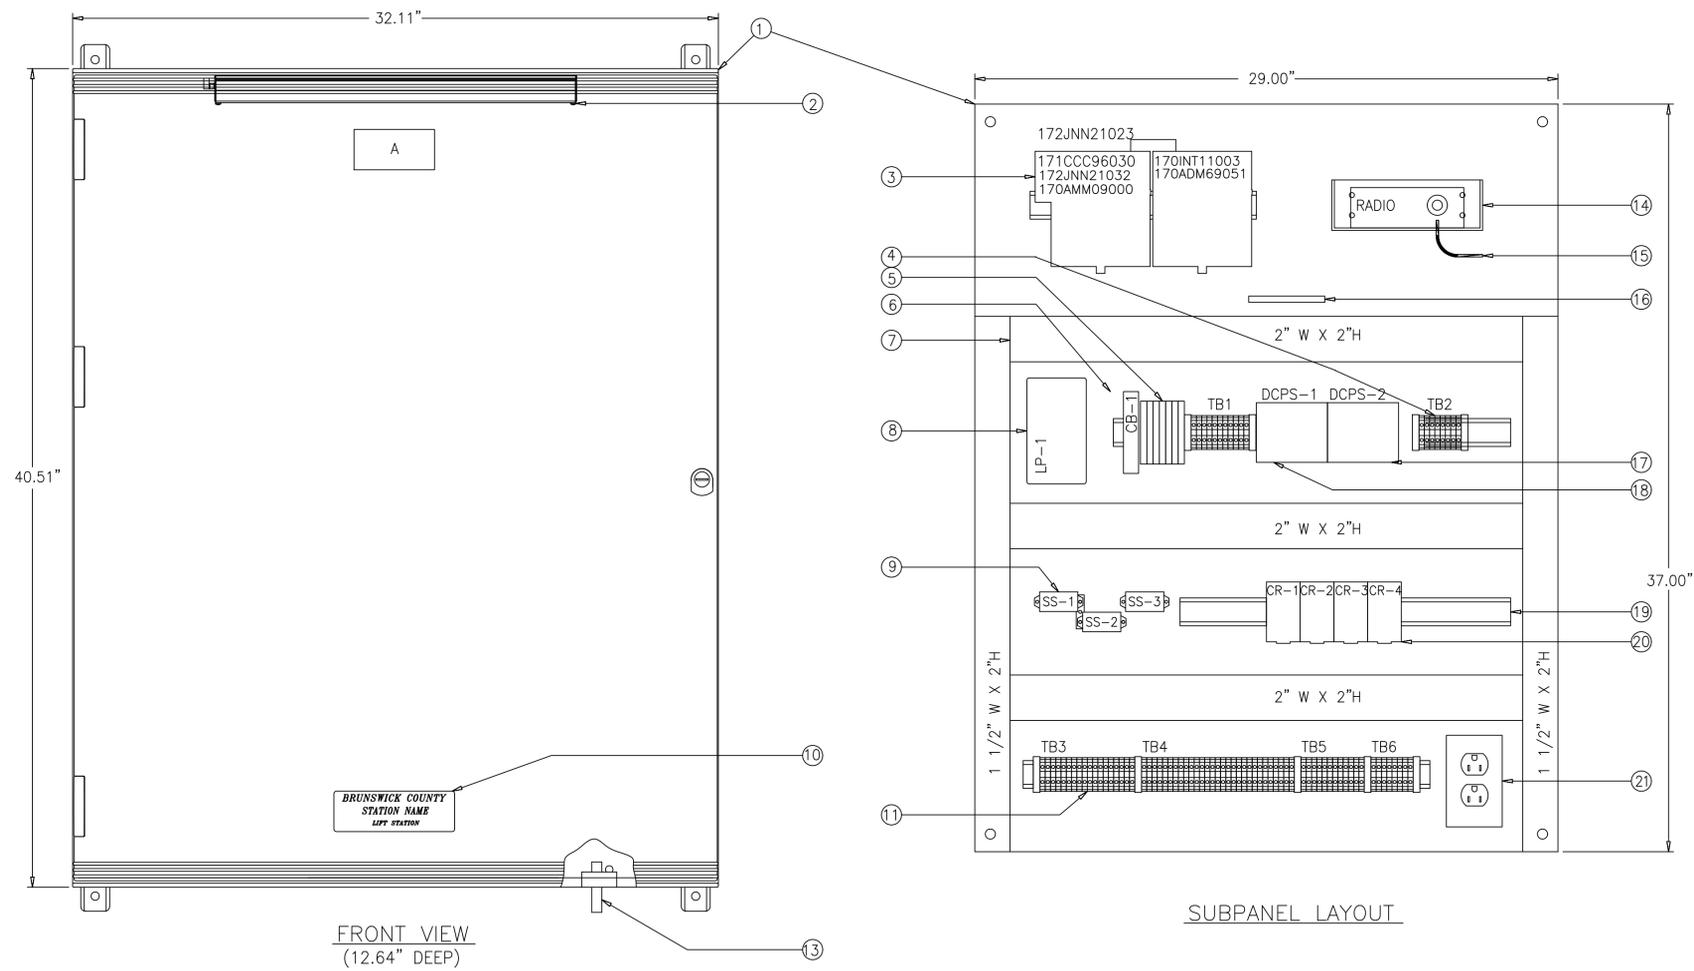

120 VAC DISTRIBUTION

TB1
FS-1
FS-2
FS-3
FS-4
FS-5
FS-6
1
2
3
4
5
6
7
8
9
10
11


I/O TERMINATIONS

TB3
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
TB4
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
TB5
1
2
3
4
5
6
7
8
9
10
11
12
TB6
1
2
3
4
5
6
7
8

12/24 VDC DISTRIBUTION

TB2
FSDC-1
FSDC-2
FSDC-3
FSDC-4
FSDC-5
SPARE
SPARE

SUBPANEL LAYOUT

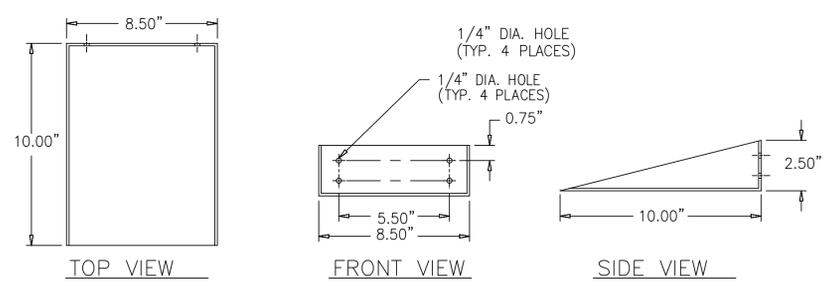

FABRICATE FROM 1/8\"/>

RTU PANEL
 FRONT ELEVATION &
 PANEL LAYOUT DETAIL